

THE MIDLANDS ELECTRICITY BOARD

CONSENT OF THE OWNER/OCCUPIER TO THE PLACING OF
ELECTRIC LINES ACROSS LAND.

To THE MIDLANDS ELECTRICITY BOARD.

Pursuant to Section 22 (1) of the Electricity (Supply) Act, 1919,

I We, Gloucestershire County Council

(hereinafter referred to as "the Owner/Occupier" which expression where the context so admits includes executors administrators and assigns) **hereby consent** to the Midlands Electricity Board (hereinafter referred to as "the Board") placing maintaining and repairing electric lines { below above ground across land owned and occupied by me situate in the parish of

Mitcheldean in the County of **Gloucester**

in the position shown by a **pink** coloured line on Plan No. **CG.9751**

annexed hereto upon the following terms and conditions.

(1) The nature of the said electric lines shall be as follows:—

Overhead conductors for transmitting electricity supported by **wood poles** at a height above the said land of not less than **17** feet, together with **3** { steel towers, poles, stays any necessary earth wires earth plates pole-mounted transformers switches and other equipment required by the Board.

Underground cable or cables for transmitting electricity laid at a depth of not less than **-** inches below the surface of the said land.

(2) The said electric lines shall be placed in the position indicated upon the said Plan but the Board may take such reasonable deviations from the said position as may be found necessary or desirable.

(3) The Board shall during the continuance of this consent until the said electric lines shall be removed from the said land pay to the Owner/Occupier in advance on the first day of **January** in each year an annual rental of £ **1 : 5 : 6** (**One** Pounds **Five** Shillings

Six Pence) made up in accordance with the Schedule hereto the first of such payments being proportioned from the date of commencing the placing of the said electric lines to the last day of **December** then next following.


(4) The Owner/Occupier shall indemnify the Board against any claims for wayleave rental by the present or future lessees or tenants of the said land.

(5) This consent may be withdrawn by the Owner/Occupier upon giving to the Board twelve calendar months' previous notice in writing without prejudice to the rights and powers of the Board under the Electricity (Supply) Acts as adapted and modified by the Electricity Acts, 1947 and 1957.

(6) The Board may at any time remove the said electric lines or any part thereof.

(7) The Board shall execute all works in connection with the placing maintenance repair alteration and removal of the said electric lines with all reasonable despatch and shall make good to the reasonable satisfaction of the Owner/Occupier and indemnify him against any damage or injury to his property occasioned by the said works or by the said electric lines or the user thereof.

(8) If any dispute or difference shall arise between the Board and the Owner/Occupier in respect of the said electric lines such dispute or difference shall be referred for settlement to an arbitrator to be appointed by the Minister of Power whose decision shall be final.



Dated this.....Thirty-first....day of.....July....., 1969..

SignatureJohn Stevenson.....

AddressShire Hall.....

.....Gloucester.....

Description and Voltage of Lines **H.V. Overhead Mains, Steam Mills to Mitcheldean 11,000**

Schedule hereinbefore referred to **being in respect of 2 - "H" poles,**
1 single pole and 5 stays.

BY VIRTUE OF OWNERSHIP.

	£	s.	c.
POLE LINES.			
... ¹ ...Single Poles at 2/- each		2	0
... ² ... "H" Poles at 3/- each		6	0
... ⁵ ...Stays at 2/- each		10	0

WIRES AND APPLIANCES NOT SUPPORTED FROM
 OWNER/OCCUPIERS' LAND.

.....yds. route length of wires at 1/- per 100 yds.

UNDERGROUND CABLES.

.....yds. route length of Cable at 1/- per 100 yds.

BY VIRTUE OF OCCUPATION.

POLE LINES.			
... ¹ ...Single Poles in Hedgerows or Pasture at 1/- each		1	0
... ² ... "H" Poles in Hedgerows or Pasture at 2/- each		4	0
... ⁵ ...Stays in Hedgerows or Pasture at 6d. each		2	6
.....Single Poles in Cultivated Grassland at 3/9 each			
....."H" Poles in Cultivated Grassland at 8/- each			
.....Single Poles and Stays in Cultivated Grassland at 11/- each			
....."H" Poles and Stays in Cultivated Grassland at 15/6 each			
.....Additional Stays in Cultivated Grassland at 3/6 each			
.....Single Poles in Arable Land at 13/- each			
....."H" Poles in Arable Land at 24/- each			
.....Single Poles and Stays in Arable Land at 33/- each			
....."H" Poles and Stays in Arable Land at 44/- each			
.....Additional Stays in Arable Land at 10/- each			

WIRES AND APPLIANCES NOT SUPPORTED FROM
 GRANTOR'S LAND.

.....yds. route length of Wires at 1/- per 100 yds.

UNDERGROUND CABLES.


.....yds. route length of Cable at 1/- per 100 yds.

TOTAL £ 1 5 6

id.
ng
ice
as
ny
ng
all
he
rty
he
ice
ter

2...
...
...
...

,000
.....

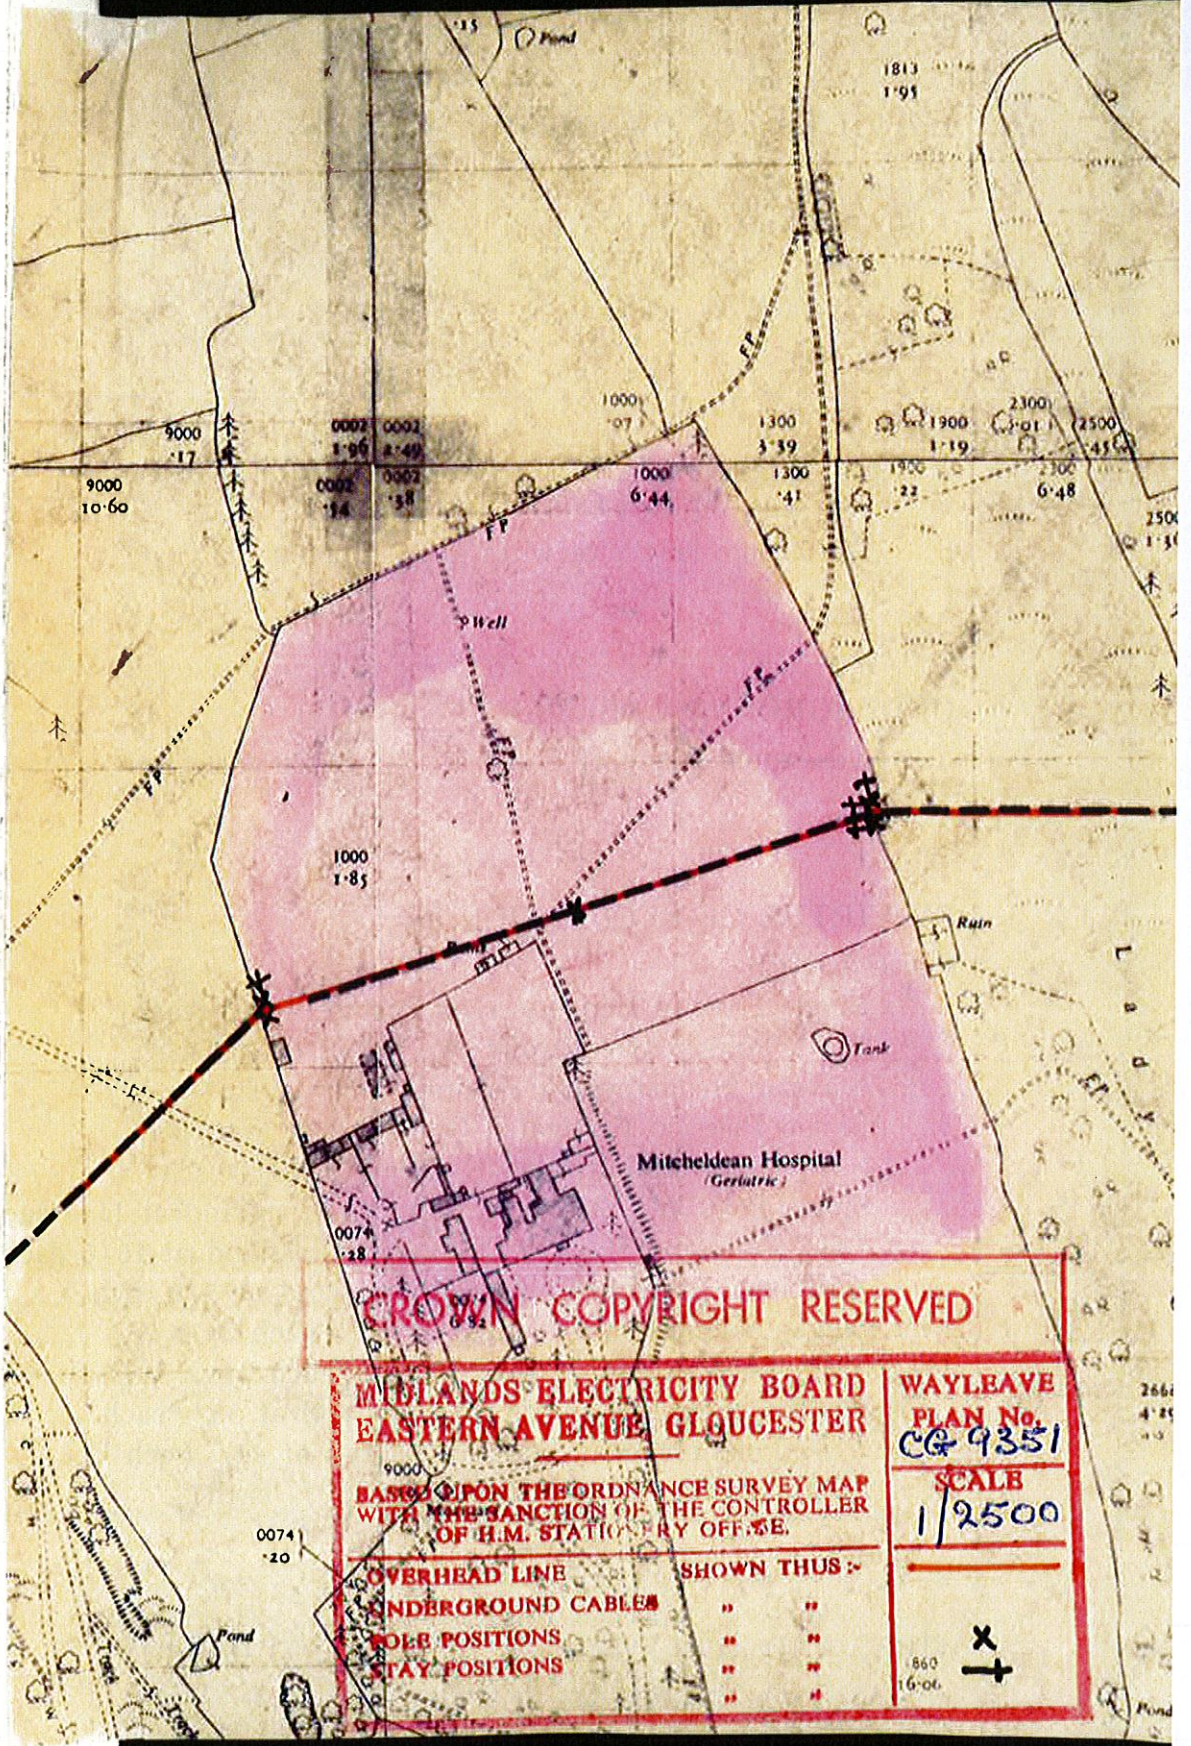



Dated 31st July 1969

**The
Midlands Electricity Board**

A N D

GLOUCESTERSHIRE COUNTY COUNCIL

**CONSENT
of OWNER/OCCUPIER
to the placing of
ELECTRIC LINES**